

REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED
01	EXTENDED OUT RIBS	09/18/12	

TANKS ARE DESIGNED TO BE USED IN A HORIZONTAL POSITION. RECTANGULAR TANKS USED IN VERTICAL POSITION MAY REQUIRE ADDITIONAL WALL THICKNESS OR EXTERNAL SUPPORT

TANKS ARE NOT RATED FOR GASOLINE OR AROMATIC SOLVENTS

TANK RESINS ARE FULLY UV STABILIZED


MOST SIZE TANKS ARE AVAILABLE IN STANDARD WALL THICKNESS SHOWN OR HEAVY DUTY

ALLOW +/- 1% ON TANK DIMENSIONS FOR OVERALL SIZE VARIANCES


VENT HOLE ON TANK WILL BE WELDED SHUT IF NOT USED FOR FITTING LOCATION

TANK PLASTIC RESIN IS FDA COMPLIANT BASED ON MANUFACTURER'S SPECIFICATIONS

TANKS MEET ABYC AND USCG REQUIREMENTS FOR MARINE WATER AND HOLDING TANK APPLICATIONS

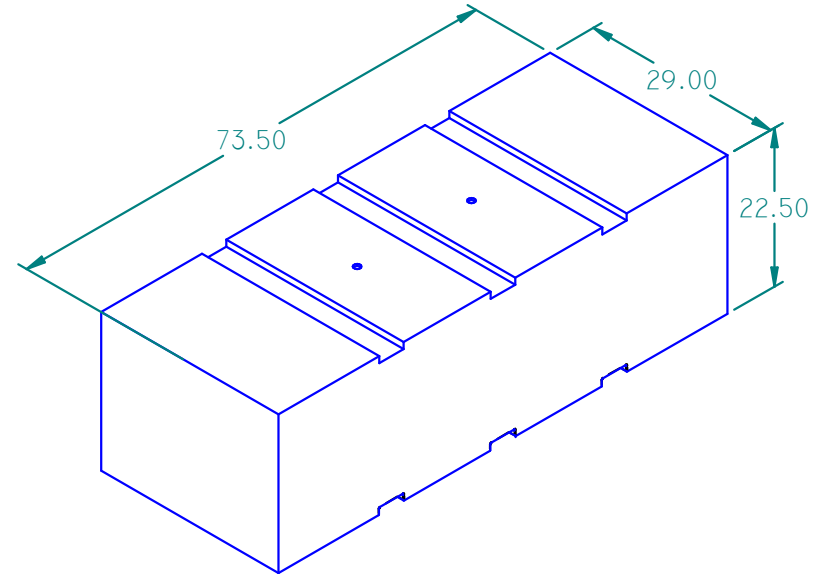

ISO VIEW 130202

TANK CAPACITY: 200 GALLONS			 16160 Hwy 27 Lake Wales, FL 33859	
NAME	DATE	TITLE		
DRAWN	MPUTT	5/8/2006	200 GALLON PLASTIC TANK	
CHECKED			SIZE A	MATERIAL: POLYETHYLENE, LOW DENSITY
ENG APPR			FILE NAME: 130202.DFT	
MGR APPR			PART#: 130202	WEIGHT: 80.457 LBM
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES ANGLES ±0.5° 2 PL ±0.125" 3 PL ±0.060"			SHEET 1 OF 1	

WALL THICKNESS: .280"

01